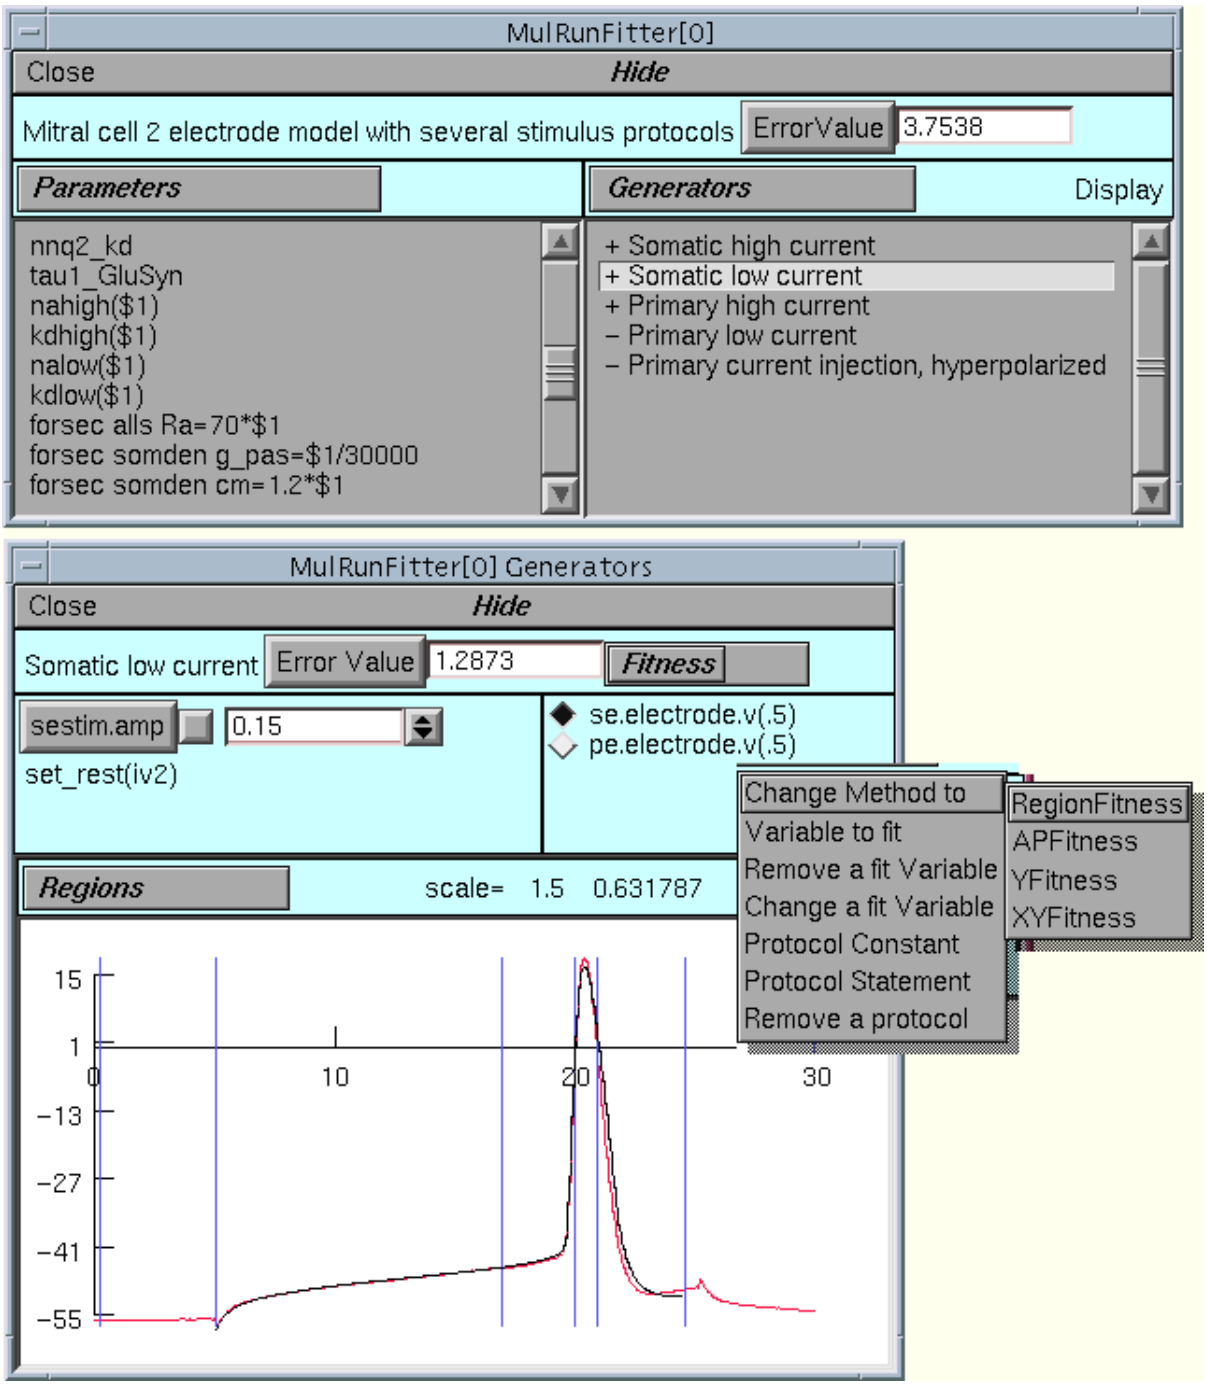
MulRunFitter[0]
Close
Hide
Mitral cell 2 electrode model with several stimulus protocols
ErrorValue
3.7538
Parameters
Generators
Display
nnq2_kd
tau1_GluSyn
nahigh($1)
kdhigh($1)
nalow($1)
kdlow($1)
forsec alls Ra=70*$1
forsec somden g_pas=$1/30000
forsec somden cm=1.2*$1
+ Somatic high current
+ Somatic low current
+ Primary high current
– Primary low current
– Primary current injection, hyperpolarized
MulRunFitter[0] Generators
Close
Hide
Somatic low current
Error Value
1.2873
Fitness
sestim.amp
0.15
set_rest(iv2)
se.electrode.v(.5)
pe.electrode.v(.5)
Change Method to
Variable to fit
Remove a fit Variable
Change a fit Variable
Protocol Constant
Protocol Statement
Remove a protocol
RegionFitness
APFitness
YFitness
XYFitness
Regions
scale= 1.5 0.631787
15
1
-13
-27
-41
-55
0
10
20
30